


- LEGEND:
- ① - 2" - 90° BEND
  - ② - 2" TEE
  - ③ - STEEL COUPLING
  - ④ - 2" VALVE
  - ⑤ - 2" STRAINER
  - ⑥ - 2" TURBO WATER METER (SEE SPECS.)
  - ⑦ - 2" PRESSURE REDUCING VALVE (SEE SPECS.)
  - ⑧ - 3/4" ALL THREADED ROOS-BOLTED THRU WALL

PLAN

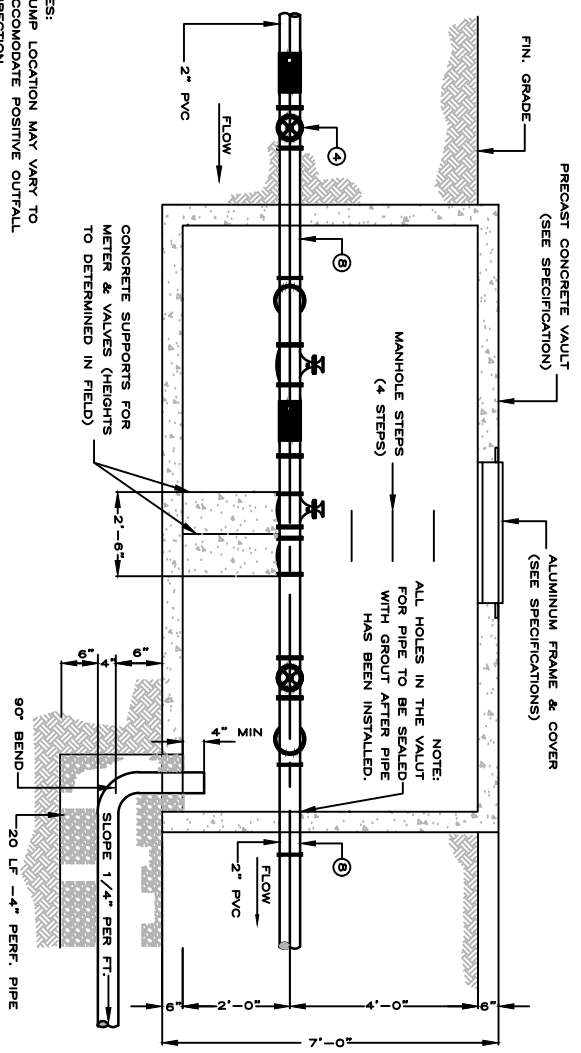

- NOTES:
1. SLUMP LOCATION MAY VARY TO ACCOMMODATE POSITIVE OUTFALL DIRECTION.
  2. ALL CONNECTIONS IN VAULT TO BE FLANGED. PIPING TO BE DUCTILE IRON.
  3. COAT ALL ALUMINUM SURFACES IN CONTACT WITH CONCRETE W/ MILS "SAFE-TAR" EPOXY CEMENT BY SOUTHERN COATINGS.

SECTION "A-A"

NOT TO SCALE

DWG. NO.

4.16

2" WATER METER BY-PASS AND VAULT DETAILS

REVISIONS

DATE	BY	DESCRIPTION
1/30/04	CKC	CREATED
5/28/22	BGM	CHANGE FONT, TITLE BLOCK, NUMBER

