


SECTIONAL PLAN

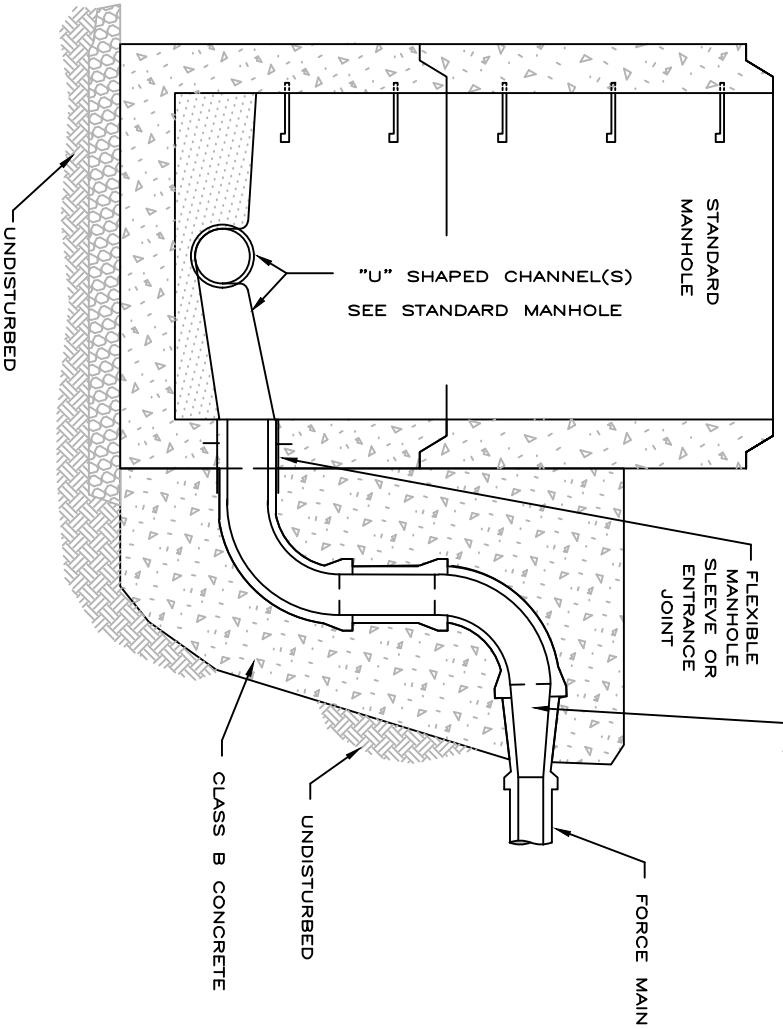

SECTION E-E

MINIMUM FORCE MAIN SIZE FOR PUBLIC SEWER MAIN SHALL BE 4" DIA.

NOT TO SCALE

REVISIONS

DATE	BY	DESCRIPTION
9/27/06	MEN	ADDED NOTES, MIN SIZE
8/24/22	BGM	CHANGE FONT, TITLE BLOCK

TYPE 2 FORCE MAIN CONNECTION

DWG. NO.

5.11

