


SECTIONAL PLAN

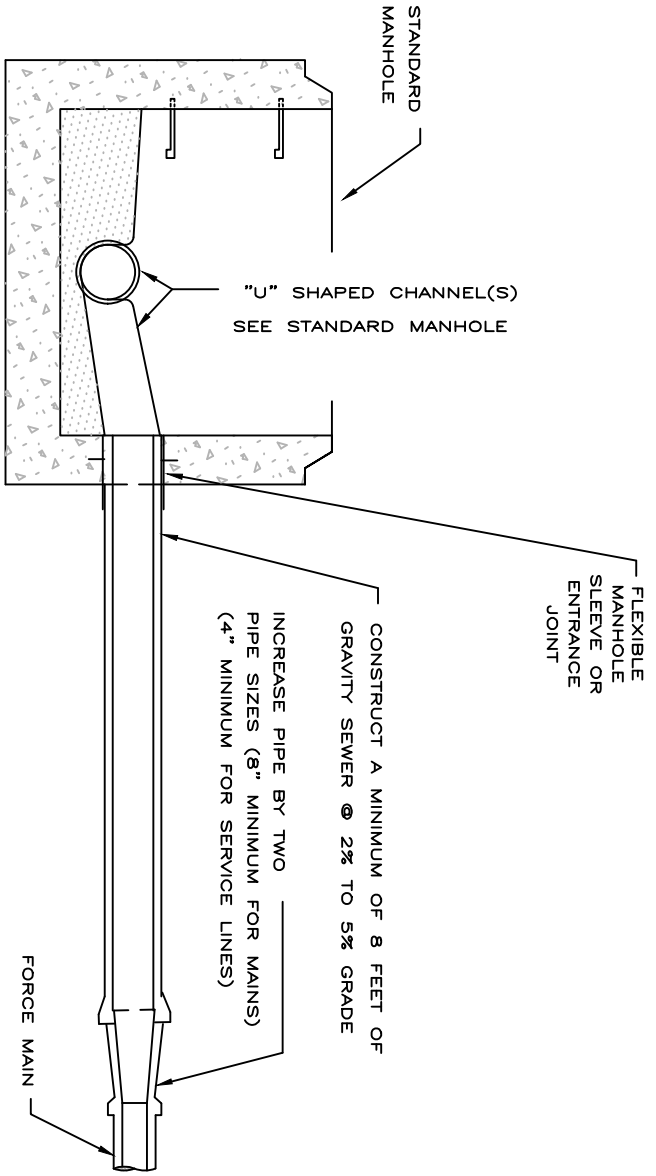

SECTION F-F

MINIMUM FORCE MAIN SIZE FOR PUBLIC SEWER SHALL BE 4" DIA.

NOT TO SCALE

REVISIONS

| DATE | BY | DESCRIPTION |
|---------|-----|--------------------------|
| 9/27/06 | MEN | ADDED NOTES, MIN SIZE |
| 8/24/22 | BGM | CHANGE FONT, TITLE BLOCK |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

TYPE 1 FORCE MAIN CONNECTION

DWG. NO.

5.10

